


IAMGOLD Line Tap Configuration

- Proposed location 130m north of existing Shiningtree DS Twr #634
- Manually operated line switch to be mounted on new LSO switch structure



Install removal jumper connection (typical) supported by post type insulators on the steel tower connecting between the T61S and T2R circuits. Jumper connection to be used as a "Normally opened MSO switch" at TWR #634B and Twr #296 (Typical)

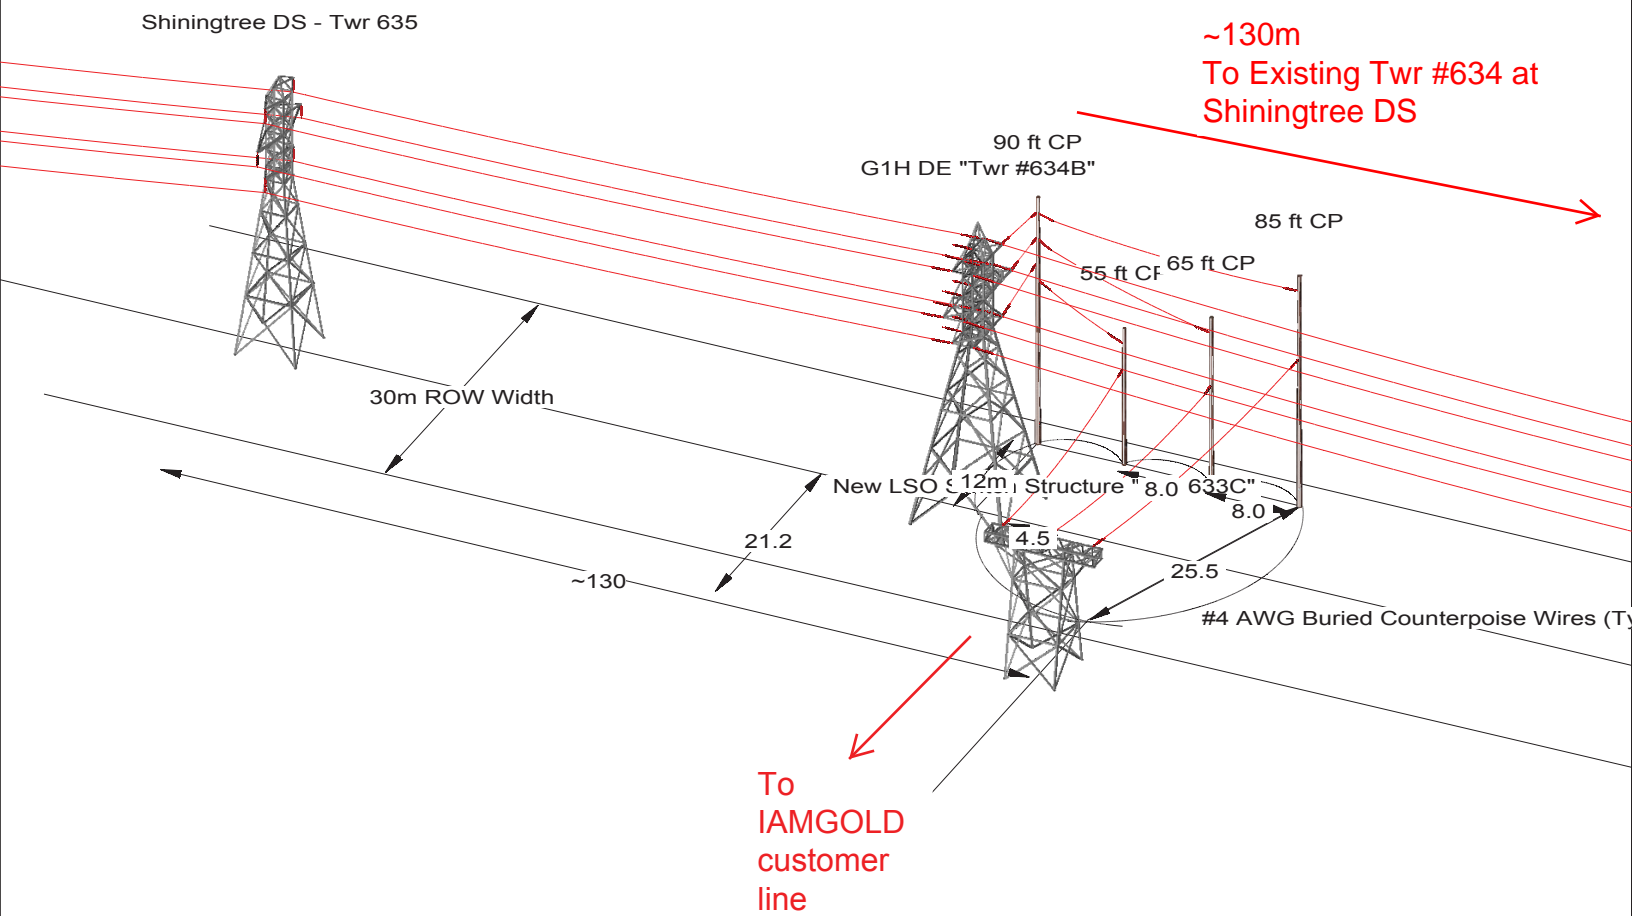