



IAMGOLD Line Tap Configuration - Proposed North Location

- Proposed location 130m north of existing Shiningtree DS Twr #634
- Manually operated line switch to be mounted on new LSO switch structure

EB-2018-0191
Attachment A
April 4, 2019

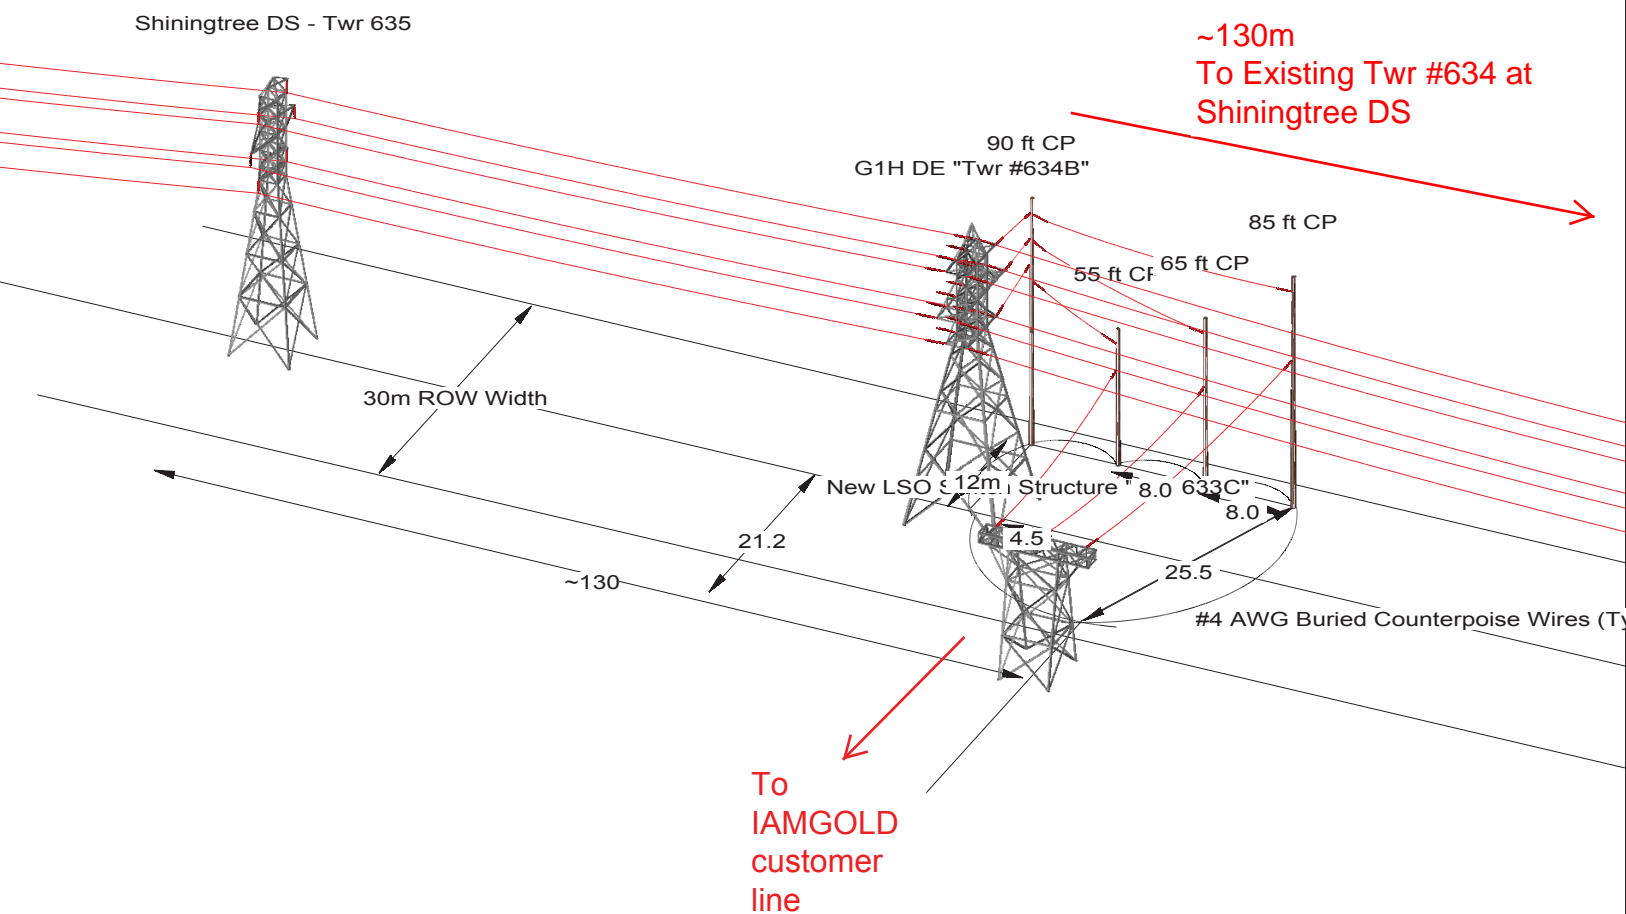

Install removable jumper connection (typical) supported by post type insulators on the steel tower connecting between the T61S and T2R circuits to be used as temporary line connection during construction at the new TWR #634B.

