



IAMGOLD Line Tap Configuration - Proposed South Location

- Proposed location 80m south of existing Shiningtree DS Twr #634
- Manually operated line switch to be mounted on new LSO switch structure

EB-2018-0191
Attachment B
April 4, 2019

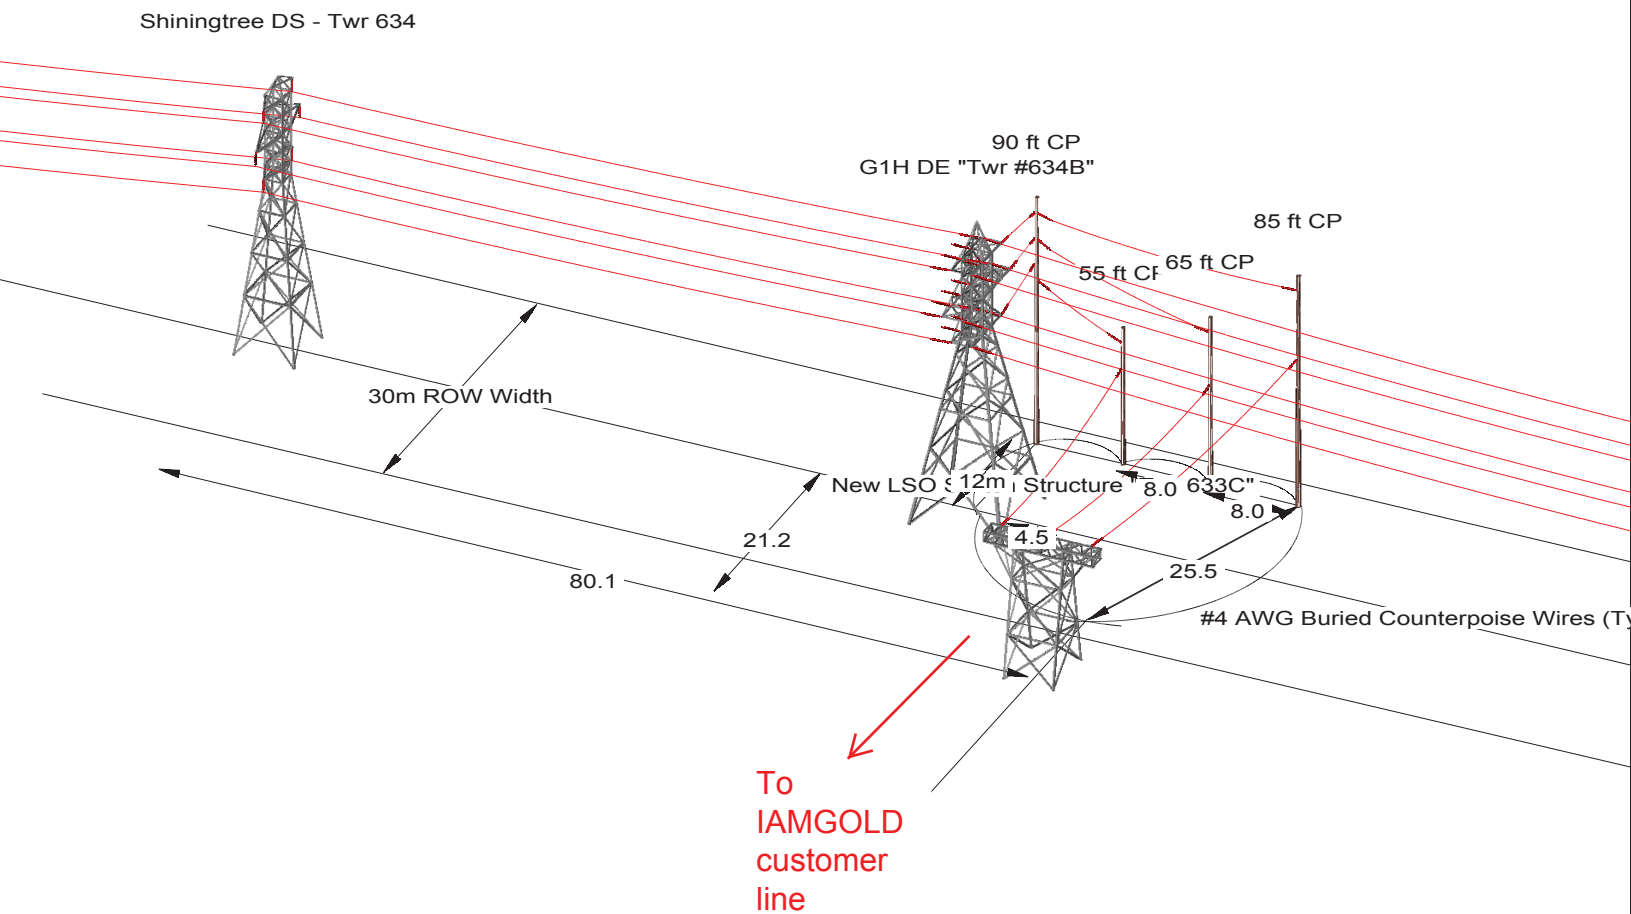

EB-2018-0191
Attachment B
April 4, 2019

Install removable jumper connection (typical) supported by post type insulators on the steel tower connecting between the T61S and T2R circuits to use as temporary line connection during construction at the new TWR #634B

90 ft CP
65 ft CP
55 ft CP
85 ft CP
G1H DE "Twr #634B"
8.0
8.0
25.5
12m
4.5
#4 AWG Buried Co
New LSO Switch Structure "Twr 634C"
MSOs (typical)
21.2
80.1
To IAMGOLD customer line

Y
Z
X

