




Overhead Power Line Clearance

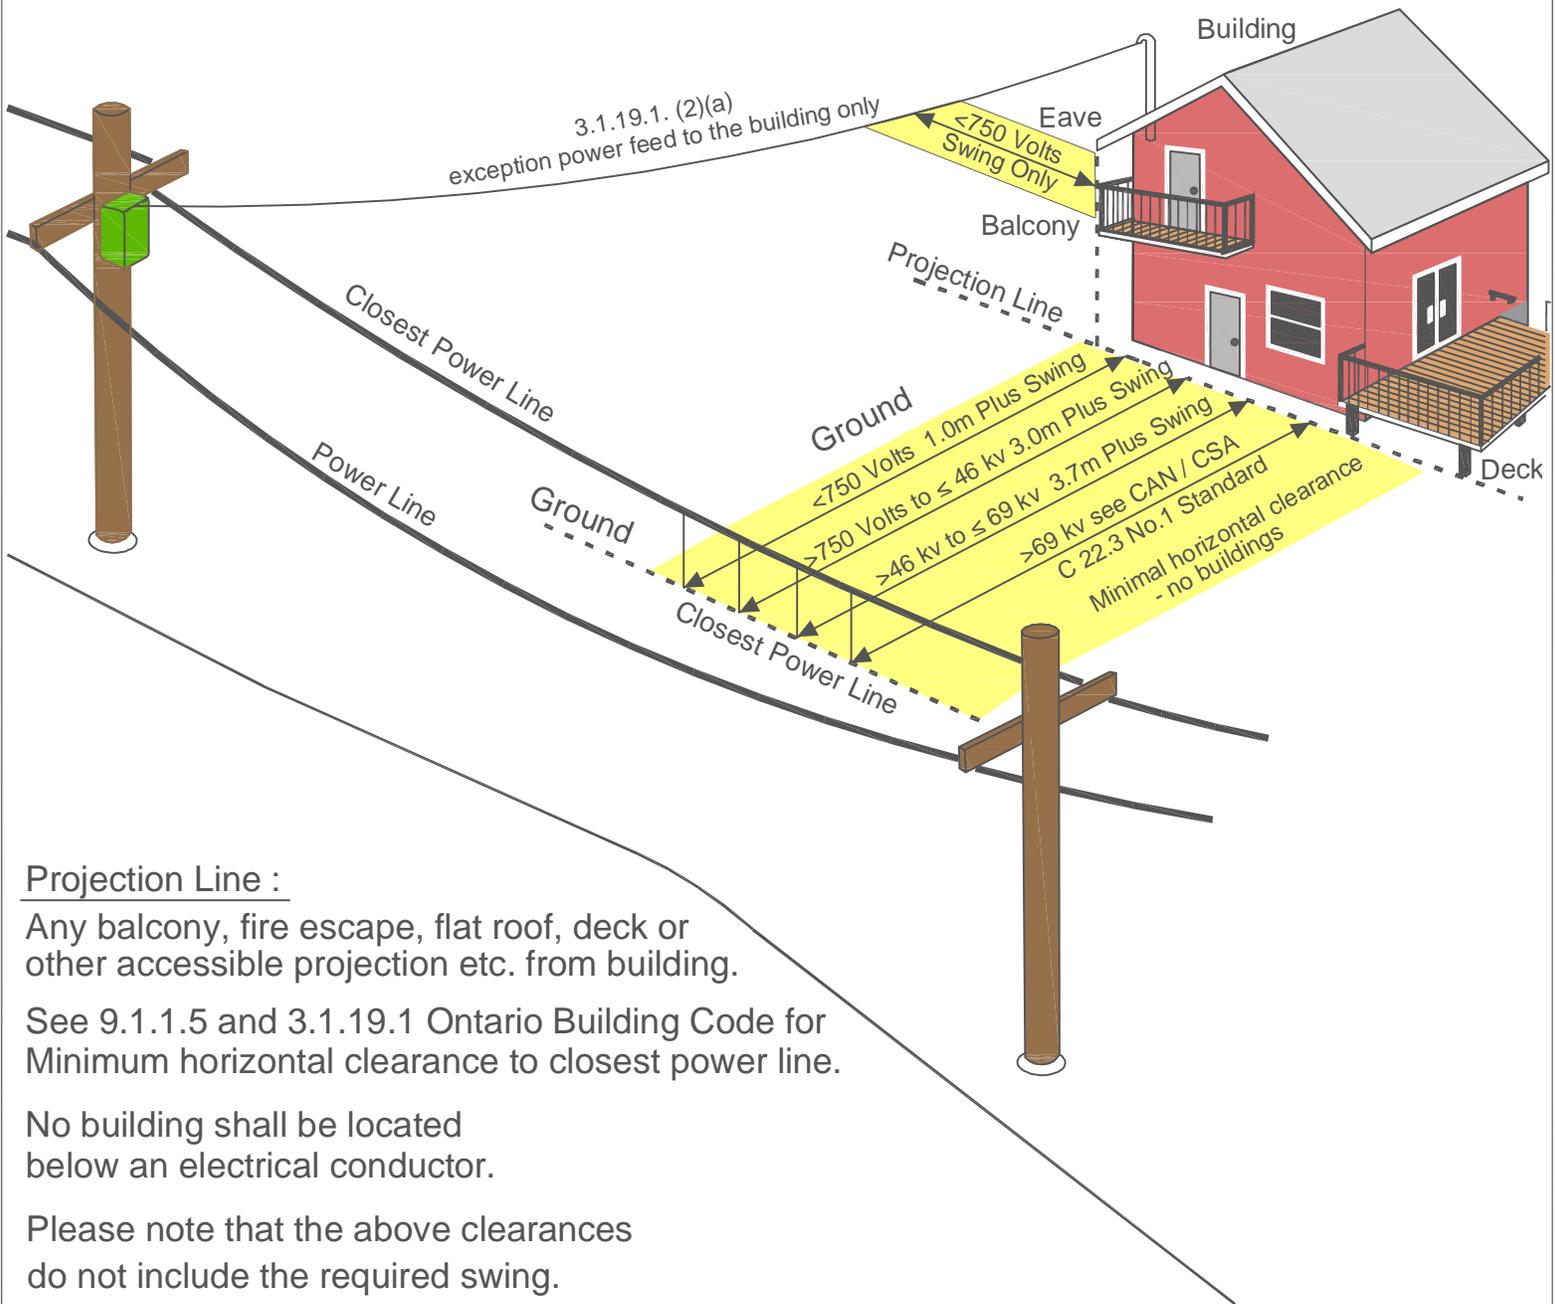

Projection Line :

Any balcony, fire escape, flat roof, deck or other accessible projection etc. from building.

See 9.1.1.5 and 3.1.19.1 Ontario Building Code for Minimum horizontal clearance to closest power line.

No building shall be located below an electrical conductor.

Please note that the above clearances do not include the required swing.

The City Building Division will consult with the P.U.C. concerning voltage of wire and what swing would apply. If ownership of the conductor is not known, the swing of 1.8m shall apply, in accordance with the Ontario Building Code.

Overhead Power Line Clearance

DWG. BY: ITI	REV. BY: DD	SFPT. 2014
--------------	-------------	------------